


Selection of RayJoint depending on casing pipe diameter.

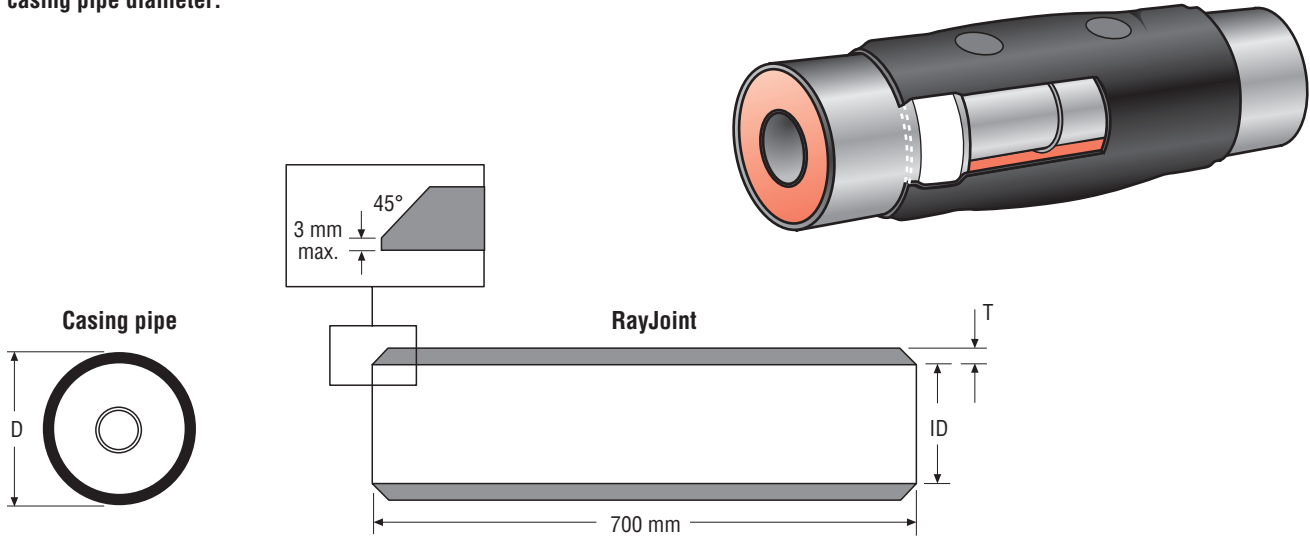

Casing pipe nominal diameter RayJoint (D) (mm)	Inner diameter (ID) RayJoint supplied min. (mm)	Inner diameter (ID) RayJoint fully recovered max. (mm)	Thickness (T) RayJoint supplied (mm)	Thickness (T) RayJoint fully recovered (mm)	Length of sealant strip S1113-RI required per RayJoint (mm)
90	105	85	2.4	3	643
110	125	100	2.4	3	775
125	142	115	2.4	3	874
140	156	125	3.2	4	973
160	177	141	3.2	4	1105
180	197	158	3.2	4	1237
200	221	177	3.2	4	1369
225	240	192	4.0	5	1584
250	270	216	4.0	5	1748
280	300	240	4.0	5	1946
315	338	270	4.8	6	2177
355	380	304	4.8	6	2491
400	430	344	5.6	7	2788
450	478	382	5.6	7	3117
500	529	423	5.6	7	3447
560	593	474	6.4	8	3843
630	664	531	6.4	8	4304
670	705	564	7.2	9	4568
710	745	596	7.2	9	4832
800	839	671	8.0	10	5425
850	891	713	8.8	11	5755
900	940	752	8.8	11	6085
950	992	794	9.6	12	6414
1000	1040	832	10.6	13	6744
1050	1090	872	11.2	14	7074
1100	1141	913	11.2	14	7403
1150	1194	955	12.0	15	7733
1200	1242	994	12.0	15	8063